

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

PRODUCE EVOLUTION



Be careful, our valves Ref.744-790-791-792 are changing

**We currently have 2 different types available (according to DN)
with different dimensions and non-commutable gaskets**

Old marking :



New marking :



At the end, only the new type will be available (from page 2 to 11)

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

NEW



Lloyd's
Register

ISO 9001 : 2015



Lloyd's
Register
PED/2014/68/EU



Certificate 3.1

Size : DN 8 to 100 mm
Ends : Threaded BSP or NPT, Socket or Butt Welding
Min Temperature : -20°C
Max Temperature : + 180°C
Max Pressure : 63 Bars up to DN20
Specifications : Anti blow-out stem
Locking device
Full bore

Materials : Stainless steel ASTM A351 CF8M

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE


SPECIFICATIONS :

- Full bore
- Anti blow-out stem
- PTFE packing
- Locking device
- Stem extension in AISI 304 (option)

USE :

- Chemical and pharmaceutical industries, petrochemical industries
- Min and max Temperature Ts : -20°C to + 180°C
- Max Pressure Ps : 63 bars up to DN20, 40 bars from DN25 to 50, 25 bars from DN65 to 80 and 20 bars for DN100 (see graph under)
- Compressed air : 10 bars max

PRESSURE / TEMPERATURE GRAPH (STEAM AND COMPRESSED AIR EXCLUDED) :

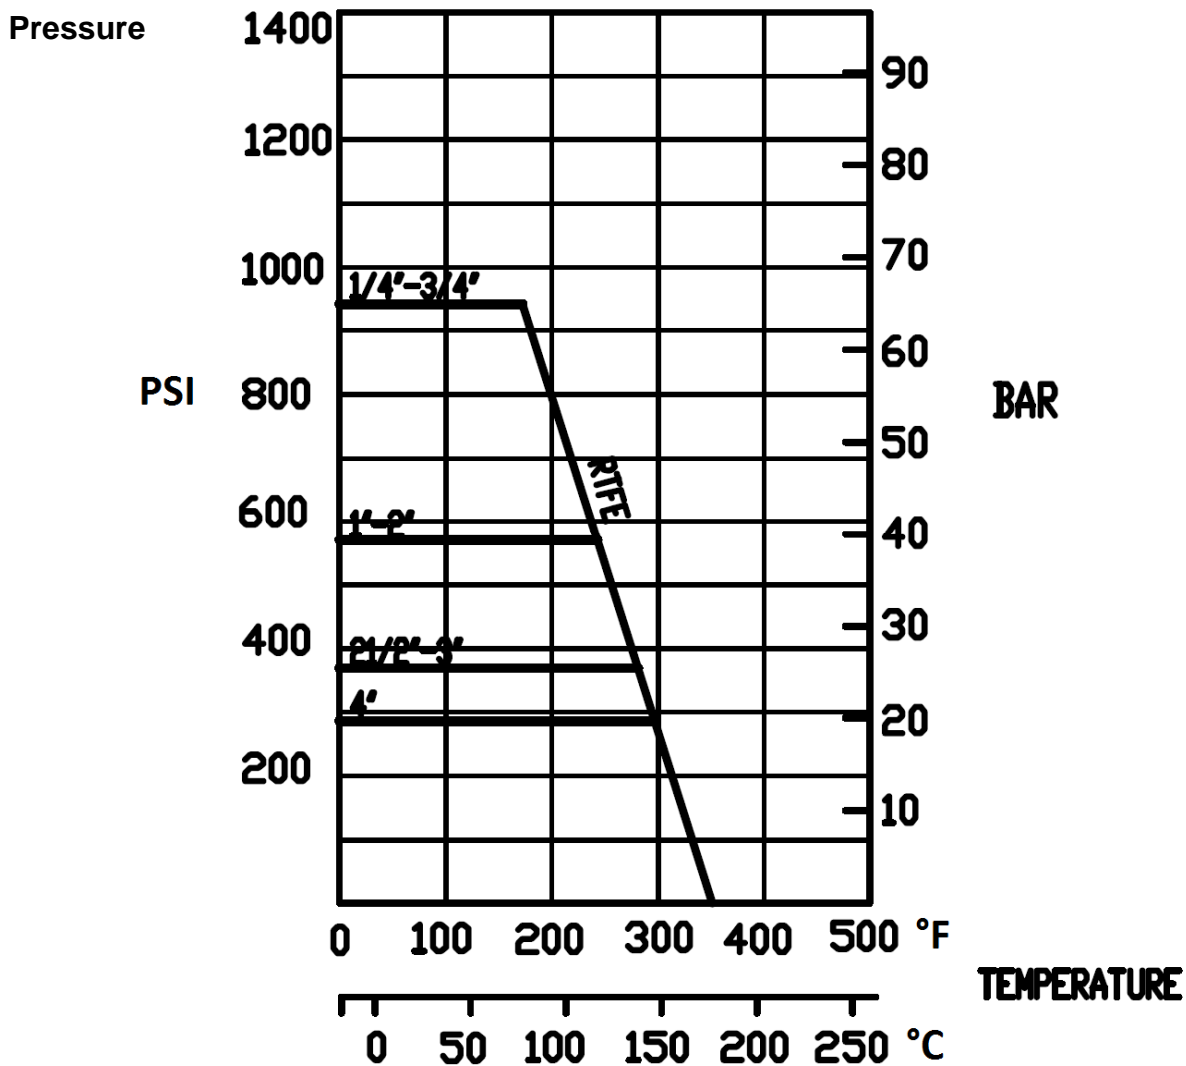

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

RANGE :



- Stainless steel 3 pieces ball valve Initial Range **Ref. 744/790/791/792** from DN 8 to DN 100



- AISI 304 stem extension **Ref.9810611-9810614** from DN8 to DN50




- Blue handle cover **Ref. 9830584-9830588** from DN 1/2" to DN 4"

ENDS :

- Female / female threaded BSP Ref. **790**
- Female / female threaded NPT Ref. **744**
- Socket Welding Ref. **792**
- Butt welding Ref. **791**

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

MATERIALS :

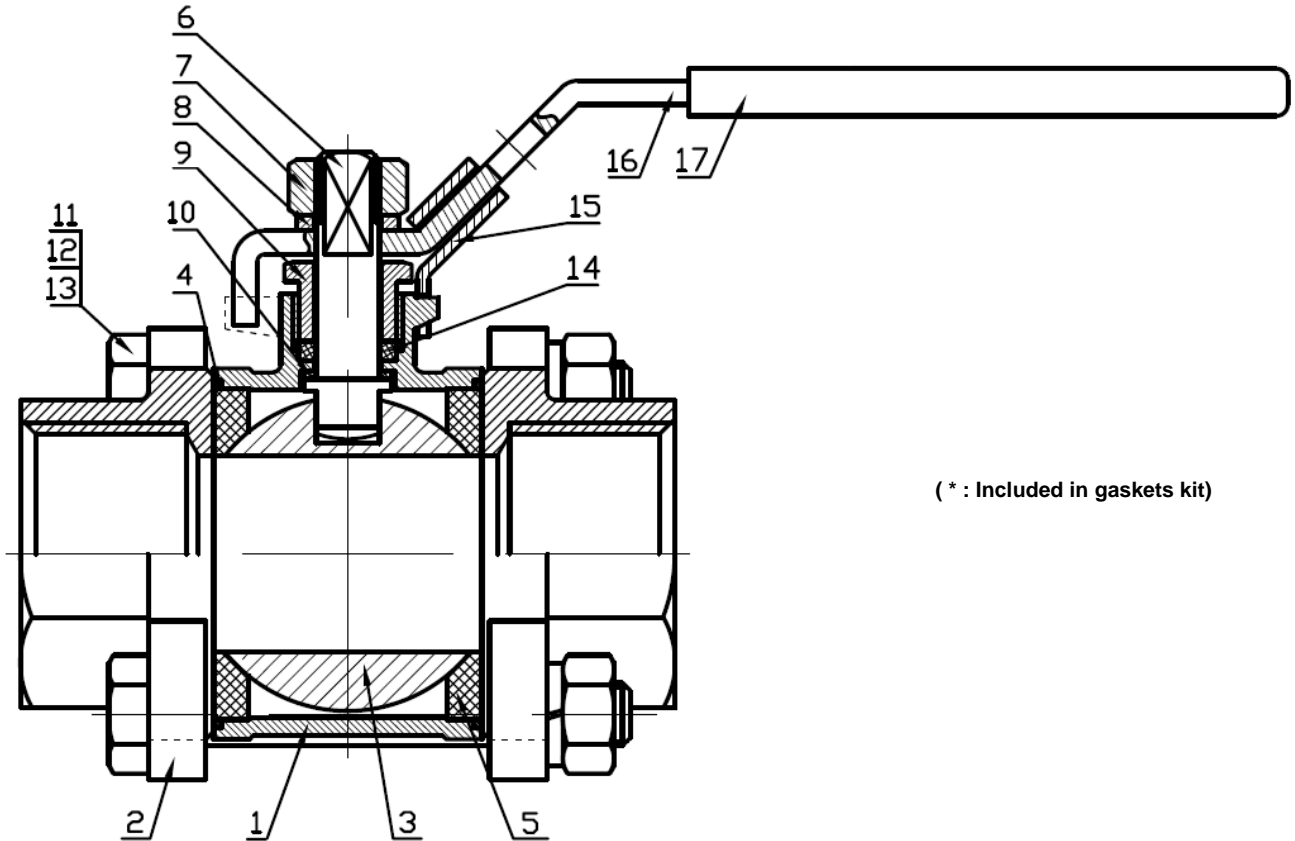


(* : Included in gaskets kit)


| Item | Designation | Materials |
|------|----------------|----------------------------------|
| 1 | Body | ASTM A351 CF8M |
| 2 | Ends | |
| 3 | Ball | AISI 316 |
| 4* | Body gasket | PTFE |
| 5* | Seat | PTFE filled with 15% glass fiber |
| 6 | Stem | AISI 316 |
| 7 | Packing nut | AISI 304 |
| 8 | Handle washer | |
| 9 | Packing gland | |
| 10* | Thrust washer | PTFE |
| 11 | Stud | AISI 304 |
| 12 | Stud washer | |
| 13 | Stud nut | |
| 14* | Packing | PTFE |
| 15 | Locking device | AISI 304 |
| 16 | Handle | |
| 17 | Handle cover | Plastic |

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

SIZE THREADED TYPES (in mm) REF. 790 / 744 :

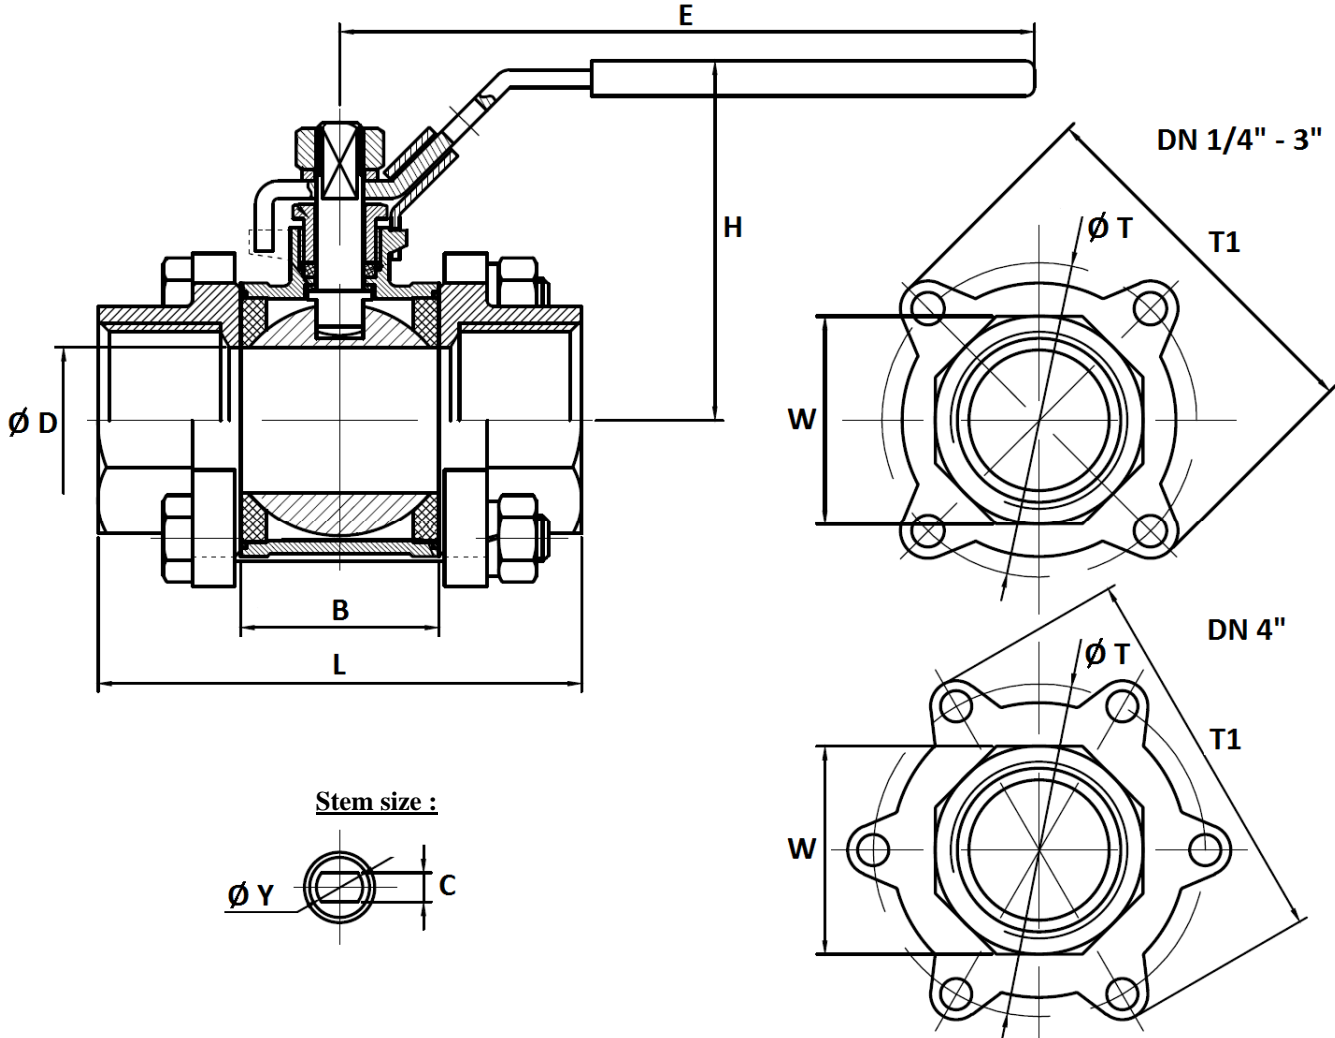


Stem size :




| Ref. | DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" | 2 1/2" | 3" | 4" |
|------------------------|-----|------|------|------|------|------|--------|--------|-------|--------|------|-------|
| 790 744 Threaded | Ø D | 11.6 | 12.5 | 15 | 20 | 25 | 32 | 38 | 50 | 64 | 76 | 100 |
| | L | 59 | 59 | 63.3 | 70.6 | 82 | 97 | 109 | 124.6 | 162 | 175 | 216 |
| | B | 21.1 | 21.1 | 23.3 | 28.6 | 34 | 44 | 51 | 63 | 84.3 | 94.7 | 119.2 |
| | E | 103 | 103 | 126 | 126 | 162 | 162 | 193 | 193 | 230 | 230 | 320 |
| | H | 49 | 49 | 57 | 62 | 72 | 78 | 91 | 102 | 122 | 132 | 177 |
| | Ø Y | M8 | M8 | M8 | M8 | M10 | M10 | M12 | M12 | M14 | M14 | M20 |
| | C | 5 | 5 | 5 | 5 | 6.5 | 6.5 | 8.5 | 8.5 | 9.8 | 9.8 | 16 |
| | Ø T | 38.5 | 38.5 | 43 | 51.5 | 58 | 70 | 81.5 | 101 | 136 | 157 | 195.5 |
| | T1 | 51 | 51 | 57.5 | 66 | 74.5 | 86.5 | 100.5 | 121.5 | 161 | 185 | 226.5 |
| | W | 18 | 21 | 26 | 32 | 39 | 48 | 55 | 67 | 83 | 99 | 127 |
| Weight (Kg) | | 0.30 | 0.30 | 0.45 | 0.60 | 0.86 | 1.32 | 2.03 | 3.19 | 7.06 | 10.7 | 20.95 |

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

SIZE B.W. TYPE (in mm) REF. 791 :

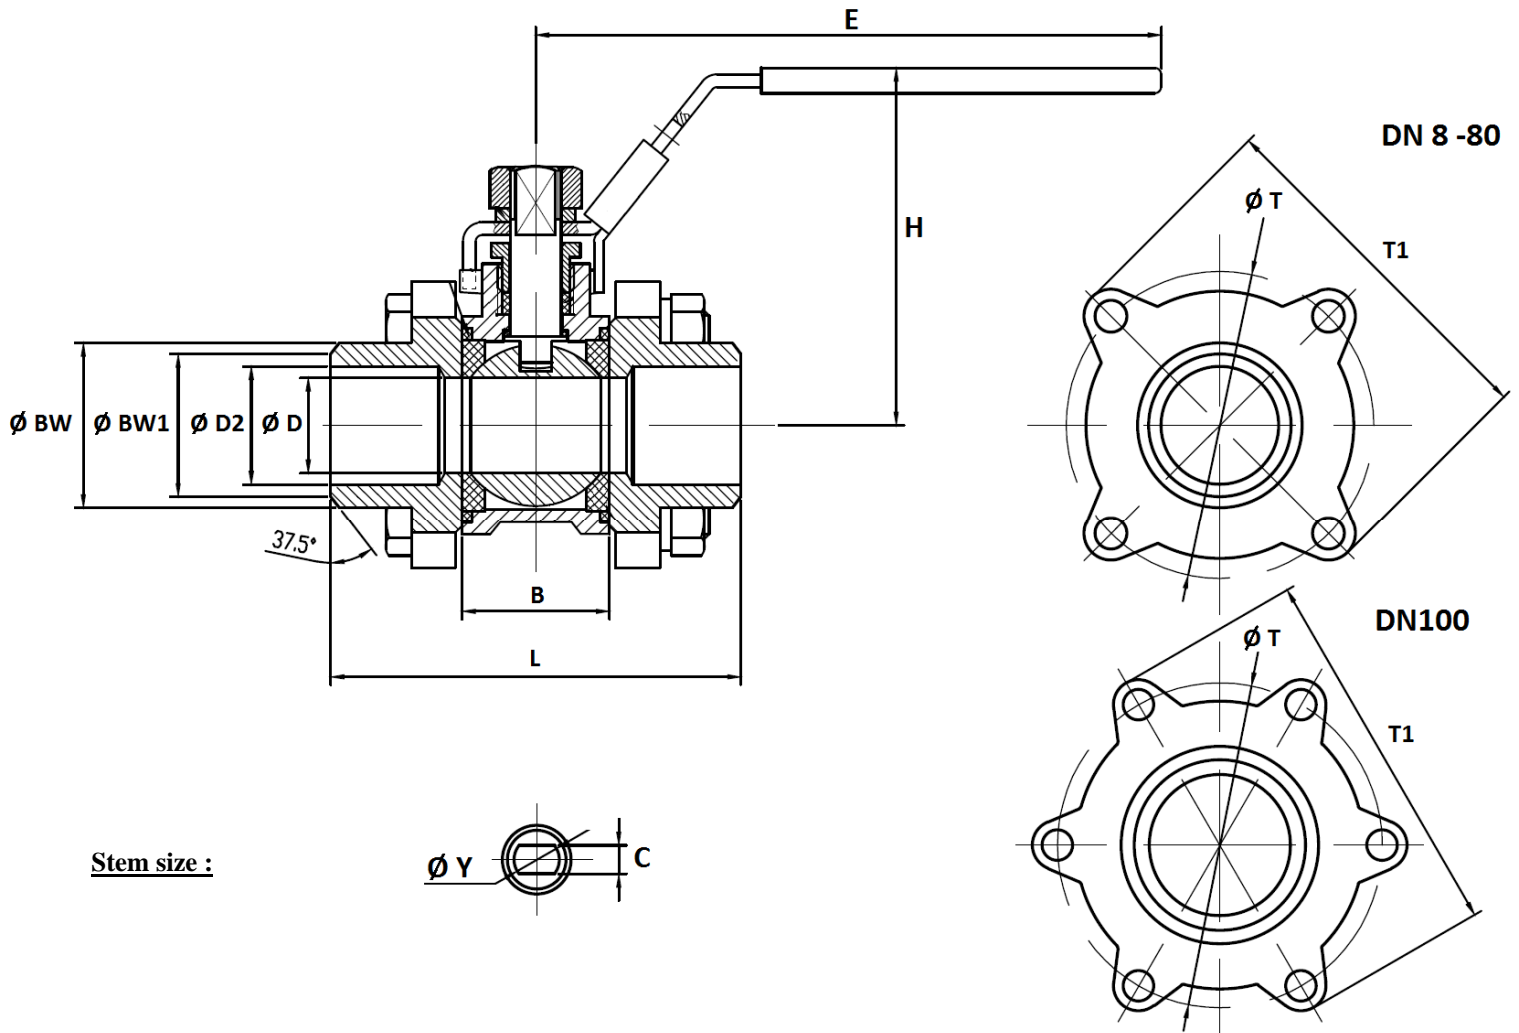


Stem size :




| Ref. | DN | 8 | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 65 | 80 | 100 |
|-----------|-------------|------|------|------|------|------|------|-------|-------|------|------|-------|
| 791 BW | Ø D | 11.6 | 12.5 | 15 | 20 | 25 | 32 | 38 | 50 | 64 | 76 | 100 |
| | L | 59 | 59 | 63.3 | 70.6 | 82 | 97 | 109 | 124.6 | 162 | 175 | 216 |
| | B | 21.1 | 21.1 | 23.3 | 28.6 | 34 | 44 | 51 | 63 | 84.3 | 94.7 | 119.2 |
| | E | 103 | 103 | 126 | 126 | 162 | 162 | 193 | 193 | 230 | 230 | 320 |
| | H | 49 | 49 | 57 | 62 | 72 | 78 | 91 | 102 | 122 | 132 | 177 |
| | Ø Y | M8 | M8 | M8 | M8 | M10 | M10 | M12 | M12 | M14 | M14 | M20 |
| | C | 5 | 5 | 5 | 5 | 6.5 | 6.5 | 8.5 | 8.5 | 9.8 | 9.8 | 16 |
| | Ø T | 38.5 | 38.5 | 43 | 51.5 | 58 | 70 | 81.5 | 101 | 136 | 157 | 195.5 |
| | T1 | 51 | 51 | 57.5 | 66 | 74.5 | 86.5 | 100.5 | 121.5 | 161 | 185 | 226.5 |
| | Ø BW | 15.5 | 17.5 | 22 | 27.3 | 34 | 42.7 | 48.7 | 61 | 76.5 | 90 | 115 |
| | Ø BW1 | 13.3 | 14.5 | 17 | 22.5 | 28.6 | 36 | 43 | 54 | 68 | 84 | 104 |
| | Ø D2 | 11.6 | 12.5 | 15 | 20 | 25 | 32 | 39.8 | 50 | 64 | 76 | 100 |
| | Weight (Kg) | | 0.30 | 0.30 | 0.45 | 0.60 | 0.86 | 1.35 | 2.03 | 3.19 | 7.06 | 10.7 |

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

SIZE S.W. TYPE (in mm) REF. 792 :

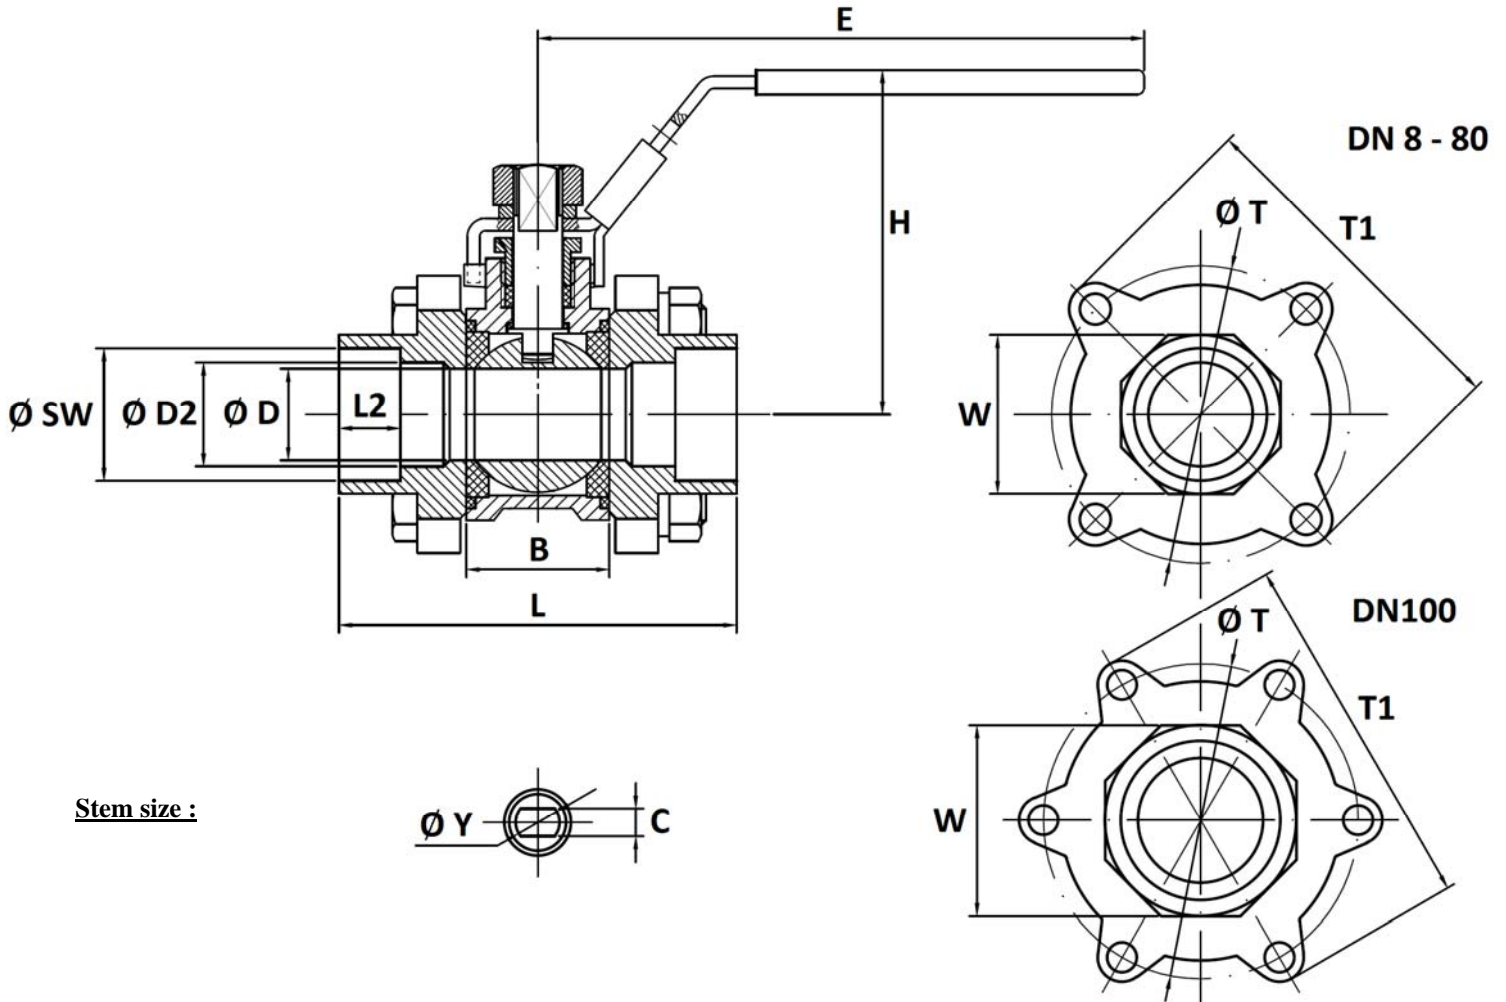


Stem size :



| Ref. | DN | 8 | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 65 | 80 | 100 |
|-----------|-------------|------|------|------|------|------|------|-------|-------|------|------|-------|
| 792 SW | Ø D | 11.6 | 12.5 | 15 | 20 | 25 | 32 | 38 | 50 | 64 | 76 | 100 |
| | Ø D2 | 11.6 | 14.5 | 18 | 23.5 | 29.5 | 38.5 | 44.5 | 56 | 68 | 83 | 108 |
| | L | 59 | 59 | 63.3 | 70.6 | 82 | 97 | 109 | 124.6 | 162 | 175 | 216 |
| | B | 21.1 | 21.1 | 23.3 | 28.6 | 34 | 44 | 51 | 63 | 84.3 | 94.7 | 119.2 |
| | L2 | 11 | 11 | 11 | 14 | 18 | 18 | 19 | 21 | 20 | 16 | 19 |
| | E | 103 | 103 | 126 | 126 | 162 | 162 | 193 | 193 | 230 | 230 | 320 |
| | H | 49 | 49 | 57 | 62 | 72 | 78 | 91 | 102 | 122 | 132 | 177 |
| | Ø Y | M8 | M8 | M8 | M8 | M10 | M10 | M12 | M12 | M14 | M14 | M20 |
| | C | 5 | 5 | 5 | 5 | 6.5 | 6.5 | 8.5 | 8.5 | 9.8 | 9.8 | 16 |
| | Ø T | 38.5 | 38.5 | 43 | 51.5 | 58 | 70 | 81.5 | 101 | 136 | 157 | 195.5 |
| | T1 | 51 | 51 | 57.5 | 66 | 74.5 | 86.5 | 100.5 | 121.5 | 161 | 185 | 226.5 |
| | W | 18 | 21 | 26 | 32 | 39 | 48 | 55 | 67 | 83 | 99 | 127 |
| | SW | 14.1 | 17.6 | 21.9 | 27.4 | 34.2 | 42.8 | 48.8 | 61.1 | 77 | 89.9 | 115.4 |
| | Weight (Kg) | 0.30 | 0.30 | 0.45 | 0.60 | 0.86 | 1.3 | 2.03 | 3.19 | 7.06 | 10.7 | 20.95 |

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

STEM EXTENSION (in mm) :

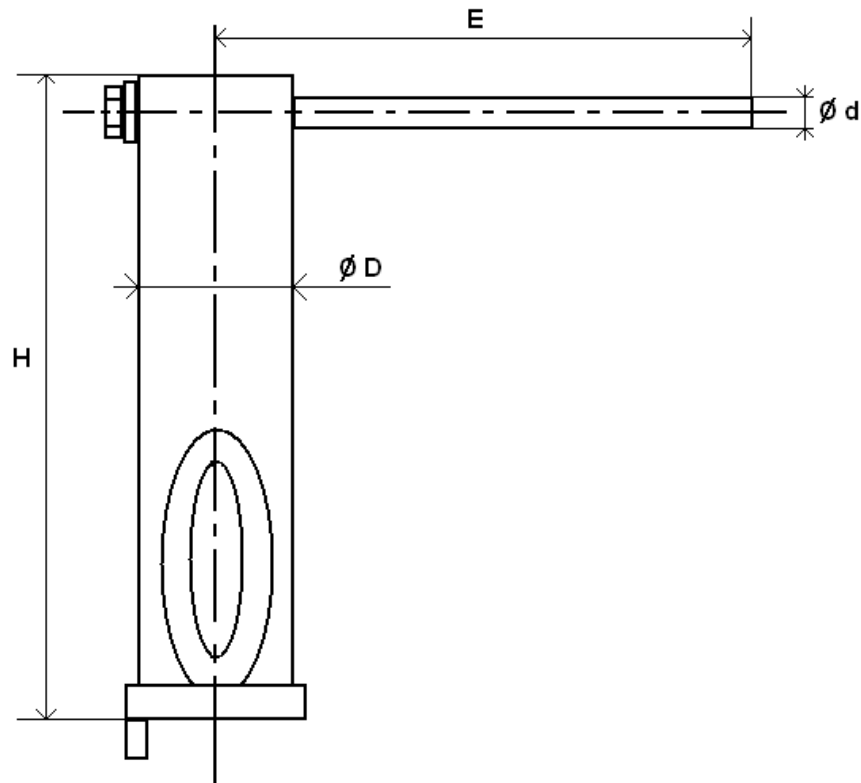

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" |
|----------------|---------|------|---------|------|---------|--------|---------|----|
| H | 126 | | 126.3 | | 126.3 | | 128 | |
| E | 124 | | 124 | | 157.8 | | 188.5 | |
| Ø D | 28 | | 28 | | 32 | | 36.5 | |
| Ø d | 12 | | 12 | | 14 | | 14 | |
| Weight (in Kg) | 0.33 | | 0.34 | | 0.48 | | 0.62 | |
| Ref. | 9810611 | | 9810612 | | 9810613 | | 9810614 | |

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE
TORQUE VALUES (In Nm without safety coefficient) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4 | 1"1/2 | 2" | 2"1/2 | 3" | 4" |
|-------------|------|------|------|------|----|-------|-------|----|-------|----|----|
| Torque (Nm) | 2 | 2 | 2.5 | 3.5 | 6 | 7 | 12 | 16 | 40 | 50 | 70 |

BOLT TIGHTENING TABLE (in Nm) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4 | 1"1/2 | 2" | 2"1/2 | 3" | 4" |
|-------------|------|------|------|------|----|-------|-------|----|-------|----|----|
| Torque (Nm) | 4 | 4 | 8 | 8 | 10 | 13 | 20 | 20 | 35 | 45 | 65 |

FLOW COEFFICIENT Kvs (M3 / h) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4 | 1"1/2 | 2" | 2"1/2 | 3" | 4" |
|--------------|------|------|------|------|------|-------|-------|-------|-------|-------|-----|
| Kvs (m3/h) | 5.2 | 5.2 | 20.7 | 30.2 | 40.6 | 70 | 90.8 | 208.4 | 275.9 | 501.6 | 865 |

STANDARDS :

- Fabrication according to ISO 9001 : 2015
- DIRECTIVE 2014/68/EU : CE N° 0038
Risk Category III Module H
- Certificate 3.1 on request
- Pressure tests according to API 598, table 6
- Threaded BSP cylindrical ends according to ISO 228-1
- Threaded NPT ends according to ANSI B1.20.1

ADVICE : Our opinion and our advice are not guaranteed and SFERACO shall not be liable for the consequences of damages.
The customer must check the right choice of the products with the real service conditions.

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

INSTALLATION AND MAINTENANCE

BEFORE INSTALLATION :

Pipe-line must be cleaned and free from residual of weldings, rubbish, shaving and every kind of extraneous materials.
 Pipe-line must be perfectly aligned and their support properly dimensioned so that there's no external constraint.

Check to use a produce compatible to the services conditions for the sealing of the threaded types.
 To tighten the ends, use the appropriate tool.
 Use the right bolt tightening so that the ends won't be damaged.

The welding of the ends for the SW and the BW types, must be done with the central part removed.
 A gauge can be used to have the good length and alignment between the ends.

INSTALLATION OF THE CENTRAL PART

During the installation of the central part, tighten bolts according to the table below. Tighten bolts in cross.

BOLT TIGHTENING TABLE (in Nm) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" | 2"1/2" | 3" | 4" |
|-------------|------|------|------|------|----|--------|--------|----|--------|----|----|
| Torque (Nm) | 4 | 4 | 8 | 8 | 10 | 13 | 20 | 20 | 35 | 45 | 65 |

CLEANING AND TESTS

Keep opened the valves during the cleaning operation so that there are no impurities between the ball and the body.

Tests under pressure must be done with a cleaned pipe-line.

Open partially the valve for tests. Pressure test do not exceed the valve specifications according to EN 12266-1.

MAINTENANCE

It's recommended to operate the valve twice (open and close) 1 to 2 times per year.

When intervention on the valve, be sure there's no pressure in the pipe-line, there's no fluid in it, and that it is isolated.
 The temperature must be low enough to operate without risks.
 If there's a corrosive fluid, inert installation before intervention.

When the valve is under pressure :

If there's a leakage between the body and the ends, tighten bolts according to the above table

If there's a leakage at the packing, tighten it slightly so that the leakage disappears.

MAINTENANCE OPERATION IN WORKSHOP

REPLACEMENT OF SEAT GASKETS AND PACKING.

The central part must be removed.

Turn the ball at 45° and removed the seat gaskets.

Operate the valve in closed position to removed the ball. Verify the surface of the ball has no impacts and no scores.

If there are important scores or impacts, replace the ball.

Clean inside the body valve and remove the impurities.

To replace the packing, remove the handle, unscrew the gland nut, extract the stem by the inside of the valve.

Clean the packing seat.

Reassemble thrust washer on stem, introduce stem by the inside of the valve, reassemble packing with packing nut, reassemble hand washer, hand nut and the handle.

Turn stem in closed position and insert the ball.

Then turn the ball in opened position and reassemble the seat.

Place the valve on the installation, tighten bolts according to the above table.

Then proceed to the tests in the same way that the first installation.

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE



Size : DN 8 to 100 mm
Ends : Threaded BSP or NPT, Socket or Butt Welding
Min Temperature : -20°C
Max Temperature : + 180°C
Max Pressure : 63 Bars up to DN20
Specifications : Anti blow-out stem
Locking device
Full bore

Materials : Stainless steel ASTM A351 CF8M

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

SPECIFICATIONS :


- Full bore
- Anto blow-out stem
- PTFE packing
- Locking device
- Stem extension in SS 304 (option)
- Blue handle cover possible

USE :

- Chemical and pharmaceutical industries, petrochemical industries
- Min and max Temperature Ts : -20°C to + 180°C
- Max Pressure Ps : 63 bars up to DN20, 40 bars from DN25 to 50, 25 bars from DN65 to 80 and 20 bars for DN100 (see graph under)

PRESSURE / TEMPERATURE GRAPH (STEAM AND COMPRESSED AIR EXCLUDED) :

Pressure (Bar)

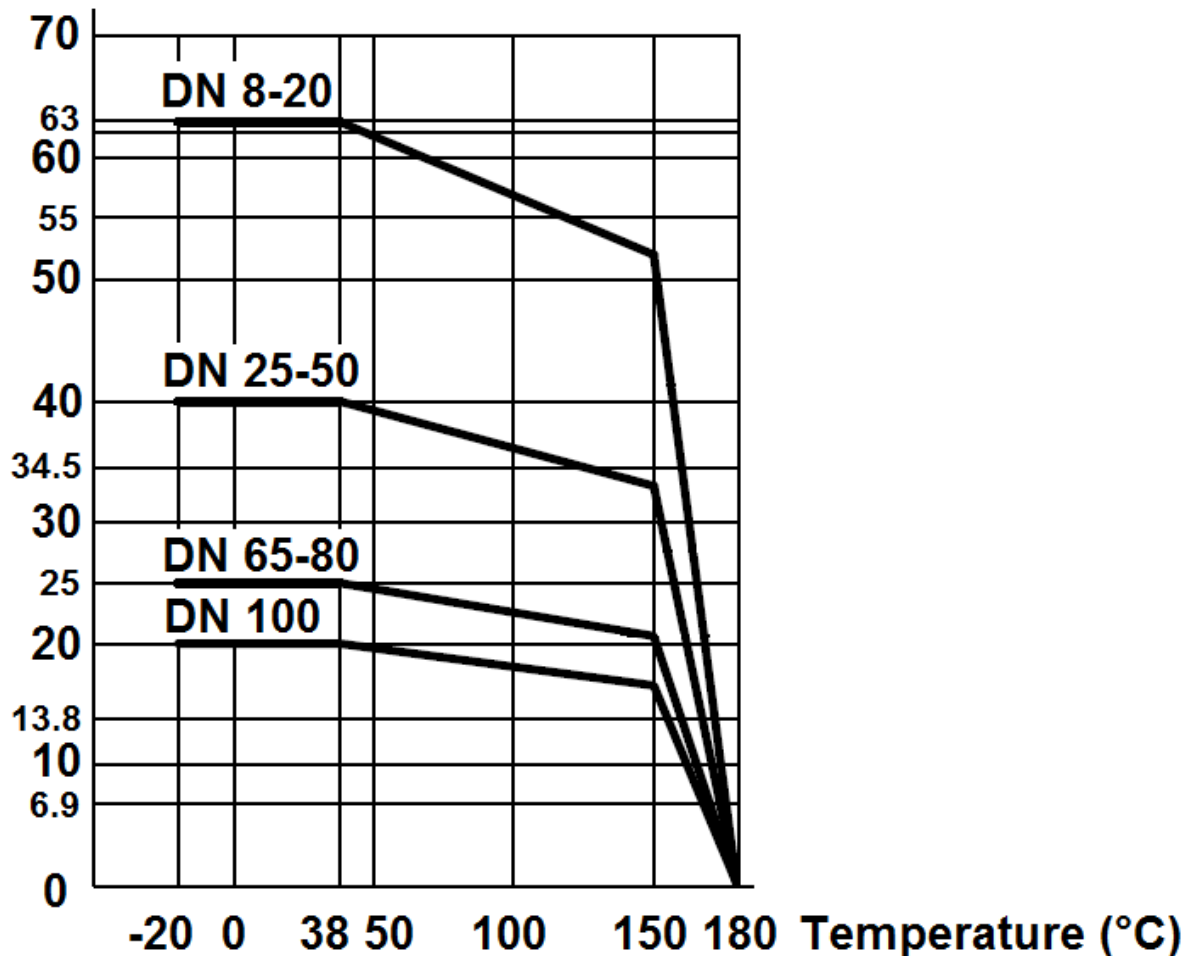

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE


RANGE :

- Stainless steel 3 pieces ball valve Ref. **744/790/791/792** from DN 8 to DN 100
- Blue handle cover Ref. **9830444-9830449** from DN 8 to DN 100

ENDS :

- Female / female threaded BSP Ref. **790**
- Female / female threaded NPT Ref. **744**
- Socket Welding Ref. **792**
- Butt welding Ref. **791**

MATERIALS FOR DN8 AND FROM DN15 TO 100 REF. 790/791/792/744 :

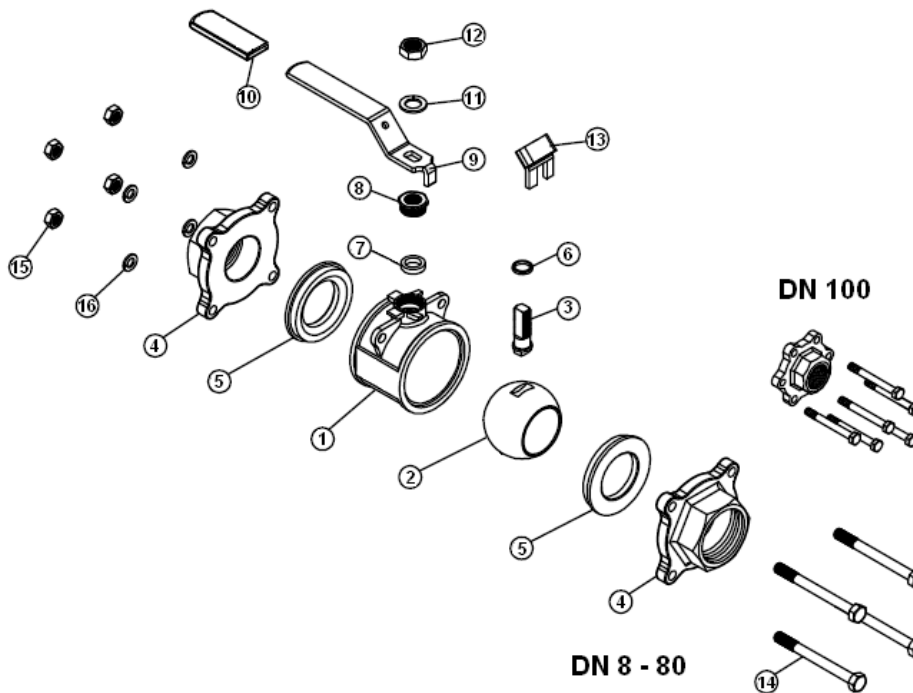


| Item | Designation | Materials Ref. 790/791/792/744 DN8 and DN15-100 |
|------|----------------|---|
| 1 | Body | ASTM A351 CF8M |
| 2 | Ball | ASTM A351 CF8M |
| 3 | Stem | SS 316 |
| 4 | Ends | ASTM A351 CF8M |
| 5* | Seat | PTFE filled with 15% glass fiber |
| 6* | Thrust washer | PTFE |
| 7* | Packing | PTFE |
| 8 | Packing nut | SS 304 |
| 9 | Handle | SS 304 |
| 10 | Handle cover | Plastic |
| 11 | Handle washer | SS 304 |
| 12 | Handle nut | SS 304 |
| 13 | Locking device | SS 304 |
| 14 | Bolt | SS 201 |
| 15 | Nut | SS 304 |
| 16 | Washer | SS 304 |

(* : Included in gaskets kit)

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

MATERIALS FOR DN10 REF. 790/791/792/744 :


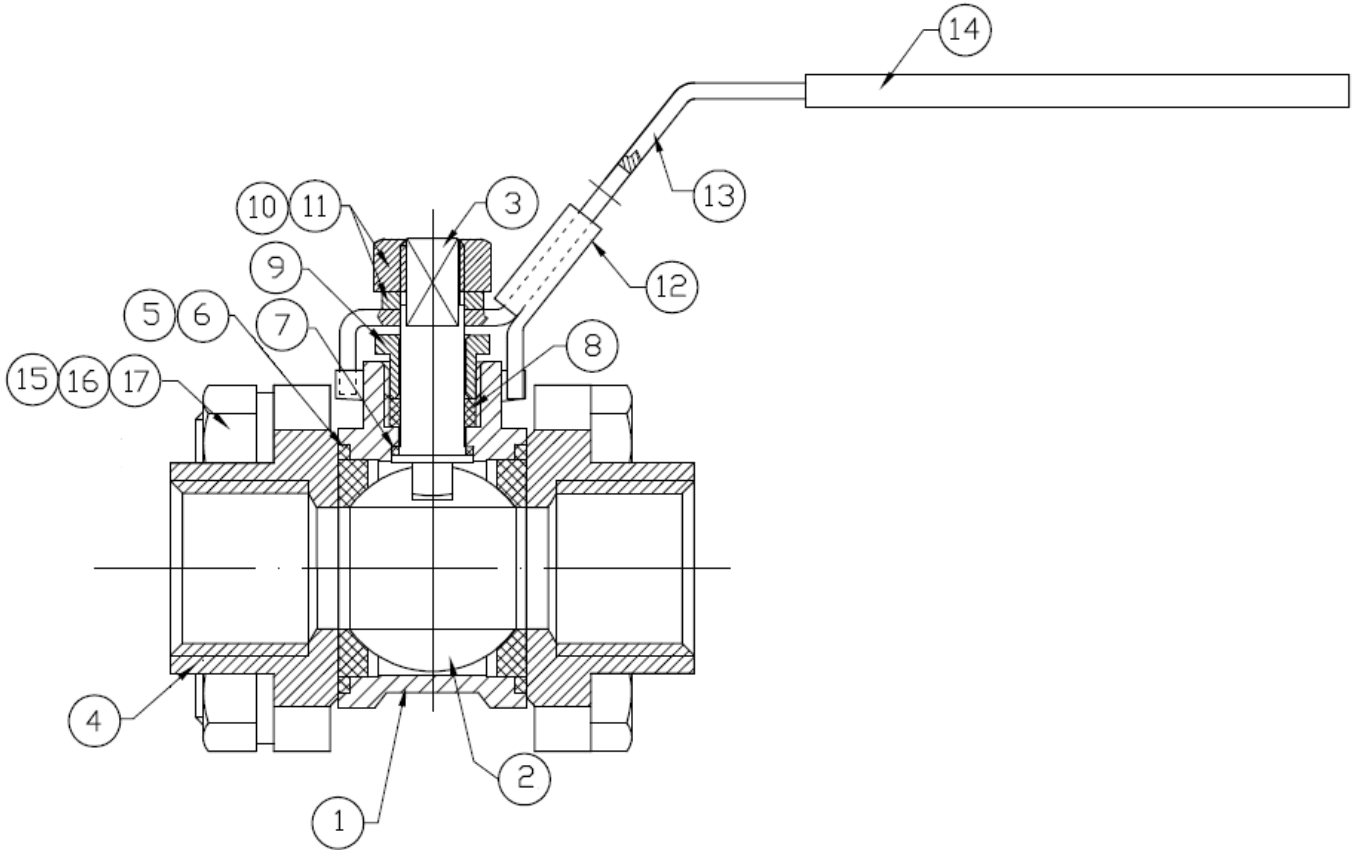


| Item | Designation | Materials Ref. 790/791/792/744 DN10 |
|------|----------------|-------------------------------------|
| 1 | Body | ASTM A351 CF8M |
| 2 | Ball | ASTM A351 CF8M |
| 3 | Stem | SS 316 |
| 4 | Ends | ASTM A351 CF8M |
| 5* | Seat | PTFE filled with 15% glass fiber |
| 6* | Body gasket | PTFE filled with 15% glass fiber |
| 7* | Thrust washer | PTFE |
| 8* | Packing | PTFE |
| 9 | Packing nut | SS 304 |
| 10 | Handle nut | SS 304 |
| 11 | Handle washer | SS 304 |
| 12 | Locking device | SS 304 |
| 13 | Handle | SS 304 |
| 14 | Handle cover | Plastic |
| 15 | Bolt | SS 201 |
| 16 | Nut | SS 304 |
| 17 | Washer | SS 304 |



(* : Included in gaskets kit)

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

SIZE THREADED STAINLESS STEEL TYPES (in mm) REF. 790 / 744 :

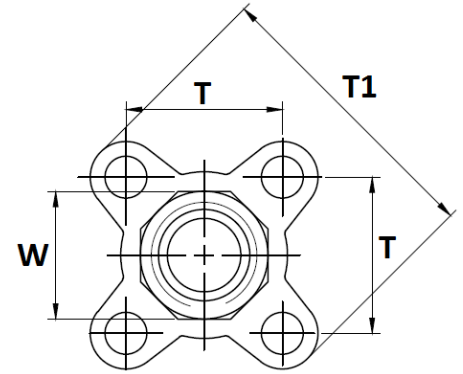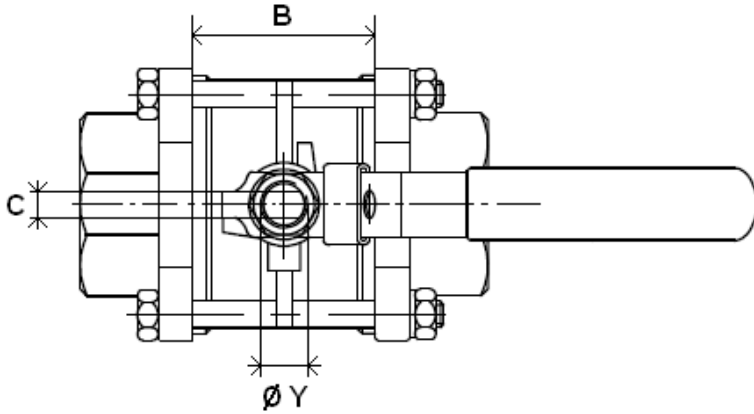

DN 1/4" - 3"

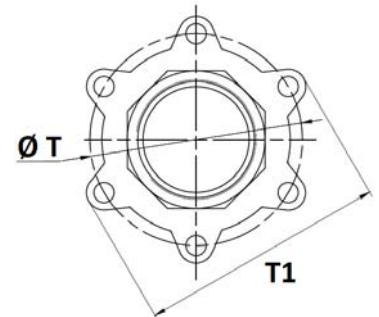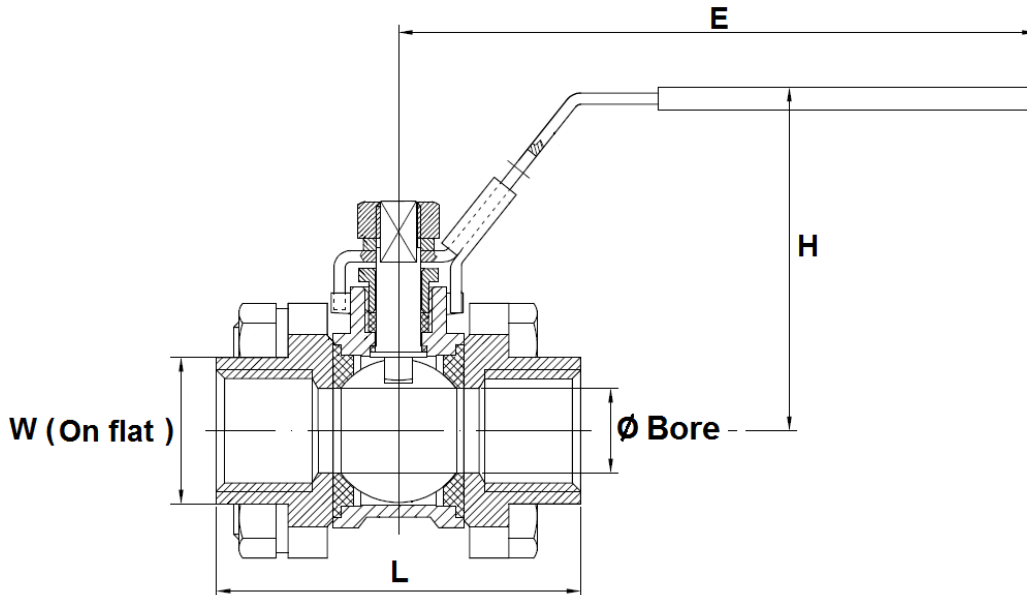


DN 4"

(2 parts seat for DN3/8")



Stem size :

| Ref. | DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" | 2"1/2" | 3" | 4" |
|----------|---------------|------|------|------|------|------|--------|--------|-------|--------|-------|-------|
| 790 | Ø Bore | 9.2 | 12.8 | 15 | 20 | 25 | 32 | 38 | 50 | 65 | 80 | 100 |
| | L | 60 | 60 | 63 | 70 | 82 | 96 | 107 | 124 | 164.6 | 182.7 | 217.7 |
| | B | 22 | 22 | 23.3 | 28 | 34 | 43 | 49 | 62.4 | 88.1 | 100.2 | 119.1 |
| | E | 136 | 136 | 136 | 136 | 165 | 165 | 190 | 190 | 300 | 300 | 335 |
| | H | 52 | 52 | 63 | 68 | 79 | 88 | 97 | 108 | 128 | 140 | 172 |
| 744 | Ø Y | 8 | 8 | 8 | 8 | 10 | 10 | 12 | 12 | 14 | 14 | 20 |
| | C | 5 | 5 | 5 | 5 | 6.5 | 6.5 | 8.5 | 8.5 | 9.8 | 9.8 | 16 |
| Threaded | T | 27.2 | 27.2 | 31.8 | 40 | 45 | 53 | 63.3 | 78.8 | 98.3 | 116.6 | 200.5 |
| | T1 | 51 | 51 | 59.5 | 71 | 80 | 91.5 | 106 | 132.8 | 164 | 194 | 231.5 |
| | W | 18 | 22 | 26 | 33 | 40 | 48 | 55 | 67 | 84.5 | 101 | 127 |
| | Weight (Kg) | 0.33 | 0.34 | 0.49 | 0.64 | 0.96 | 1.37 | 2.2 | 3.75 | 6.85 | 10.2 | 20.5 |





3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

SIZE BUTT WELDING STAINLESS STEEL TYPES (in mm) REF. 791 :

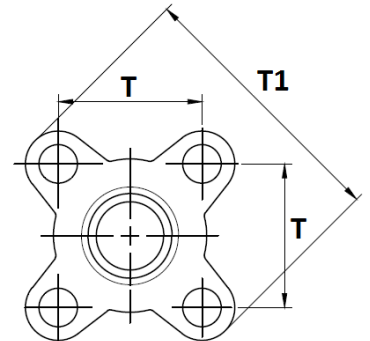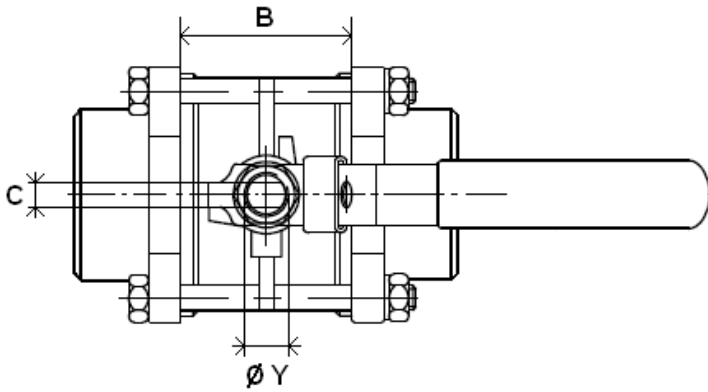

DN 1/4" - 3"

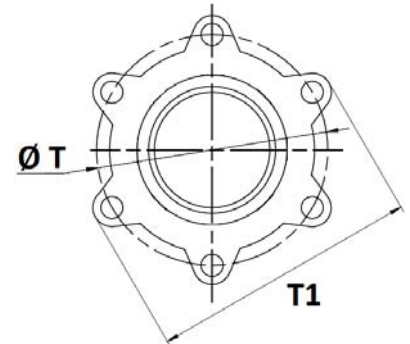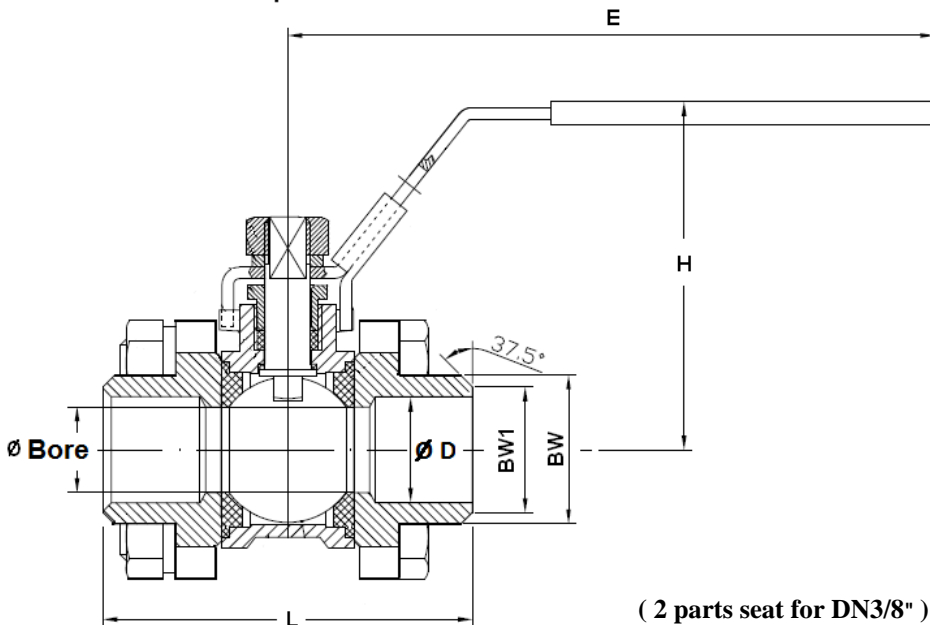


DN 4"

(2 parts seat for DN3/8")



Stem size :

| Ref. | DN | 8 | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 65 | 80 | 100 |
|------|---------------|------|------|------|------|------|------|------|-------|-------|-------|-------|
| 791 | Ø Bore | 9.2 | 12.8 | 15 | 20 | 25 | 32 | 38 | 50 | 65 | 80 | 100 |
| | L | 60 | 60 | 63 | 70 | 82 | 96 | 107 | 124 | 162.6 | 180.7 | 221.7 |
| | B | 22 | 22 | 23.3 | 28 | 34 | 43 | 49 | 62.4 | 88.1 | 100.2 | 119.1 |
| | E | 136 | 136 | 136 | 136 | 165 | 165 | 190 | 190 | 300 | 300 | 335 |
| | H | 52 | 52 | 63 | 68 | 79 | 88 | 97 | 108 | 128 | 140 | 172 |
| | Ø Y | 8 | 8 | 8 | 8 | 10 | 10 | 12 | 12 | 14 | 14 | 20 |
| B.W. | C | 5 | 5 | 5 | 5 | 6.5 | 6.5 | 8.5 | 8.5 | 9.8 | 9.8 | 16 |
| | T | 27.2 | 27.2 | 31.8 | 40 | 45 | 53 | 63.3 | 78.8 | 98.3 | 116.6 | 200.5 |
| | T1 | 51 | 51 | 59.5 | 71 | 80 | 91.5 | 106 | 132.8 | 164 | 194 | 231.5 |
| | BW | 14 | 17.5 | 22 | 27.5 | 34 | 43 | 49 | 61 | 76.5 | 90 | 115 |
| | BW1 | 12 | 14.5 | 17 | 22.5 | 28.6 | 36 | 43 | 54 | 68 | 84 | 104 |
| | Ø D | 9.2 | 12.8 | 15 | 20 | 25 | 32 | 39.8 | 50 | 65 | 80 | 100 |
| | Weight (Kg) | 0.33 | 0.33 | 0.49 | 0.64 | 0.96 | 1.37 | 2.2 | 3.75 | 6.85 | 10.2 | 20.5 |





3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

SIZE SOCKET WELDING STAINLESS STEEL TYPES (in mm) REF. 792 :

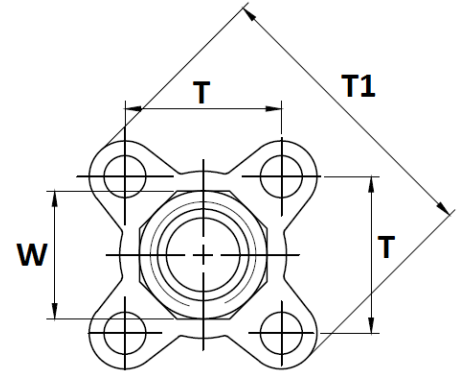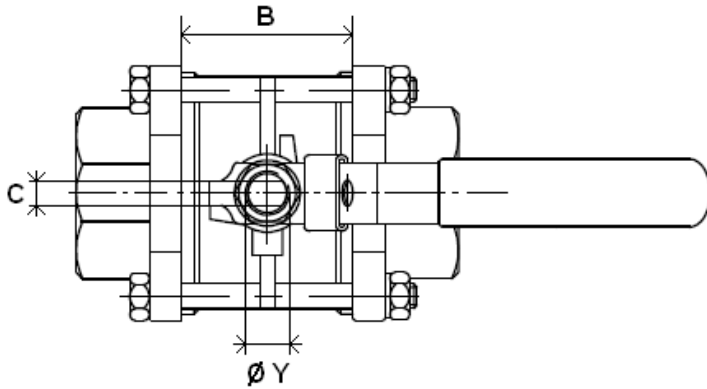

DN 1/4" - 3"

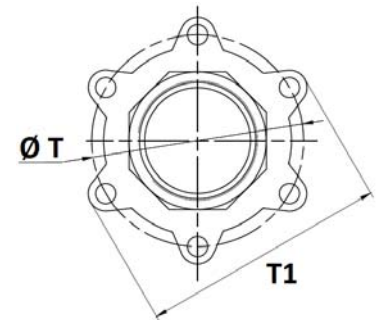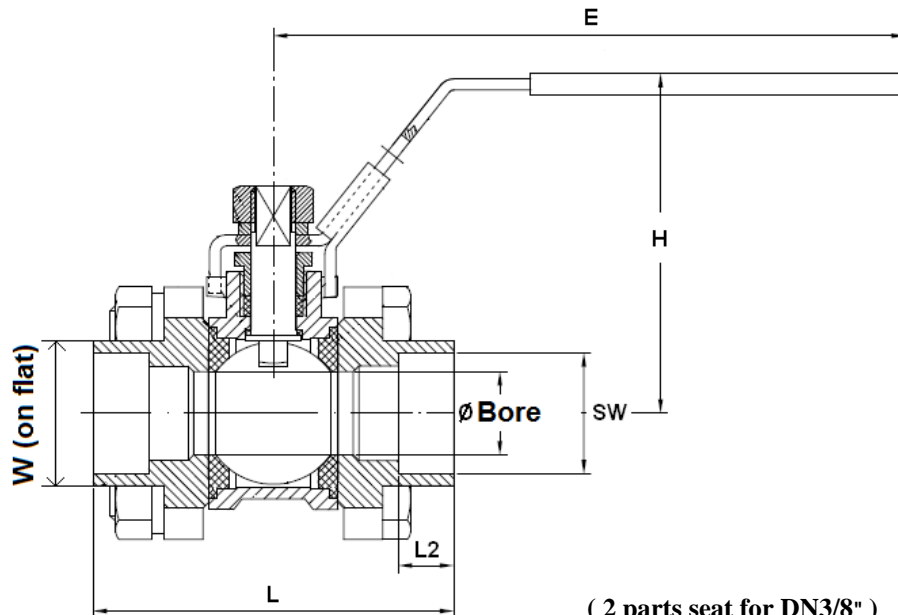


DN 4"

(2 parts seat for DN3/8")


Stem size :

| Ref. | DN | 8 | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | |
|---------------|--------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|
| 792 | Ø Bore | 9.2 | 12.8 | 15 | 20 | 25 | 32 | 38 | 50 | 65 | 80 | 100 | |
| | L | 60 | 60 | 63 | 70 | 82 | 96 | 107 | 124 | 164.6 | 182.7 | 217.7 | |
| | B | 22 | 22 | 23.3 | 28 | 34 | 43 | 49 | 62.4 | 88.1 | 100.2 | 119.1 | |
| | L2 | 10 | 10 | 10 | 13 | 13 | 13 | 13 | 16 | 16 | 16 | 19 | |
| | E | 136 | 136 | 136 | 136 | 165 | 165 | 190 | 190 | 300 | 300 | 335 | |
| | H | 52 | 52 | 63 | 68 | 79 | 88 | 97 | 108 | 128 | 140 | 172 | |
| | Ø Y | 8 | 8 | 8 | 8 | 10 | 10 | 12 | 12 | 14 | 14 | 20 | |
| | S.W. | C | 5 | 5 | 5 | 5 | 6.5 | 6.5 | 8.5 | 8.5 | 9.8 | 9.8 | 16 |
| | | T | 27.2 | 27.2 | 31.8 | 40 | 45 | 53 | 63.3 | 78.8 | 98.3 | 116.6 | 200.5 |
| | | T1 | 51 | 51 | 59.5 | 71 | 80 | 91.5 | 106 | 132.8 | 164 | 194 | 231.5 |
| | | W | 18 | 22 | 26 | 33 | 40 | 48 | 55 | 67 | 84.5 | 101 | 127 |
| | | SW | 14.1 | 17.6 | 21.9 | 27.4 | 34.2 | 42.8 | 48.8 | 61.1 | 77 | 89.9 | 115.4 |
| Weight (Kg) | | 0.33 | 0.33 | 0.49 | 0.64 | 0.96 | 1.37 | 2.2 | 3.75 | 6.85 | 10.2 | 20.5 | |



3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

STEM EXTENSION (in mm) :

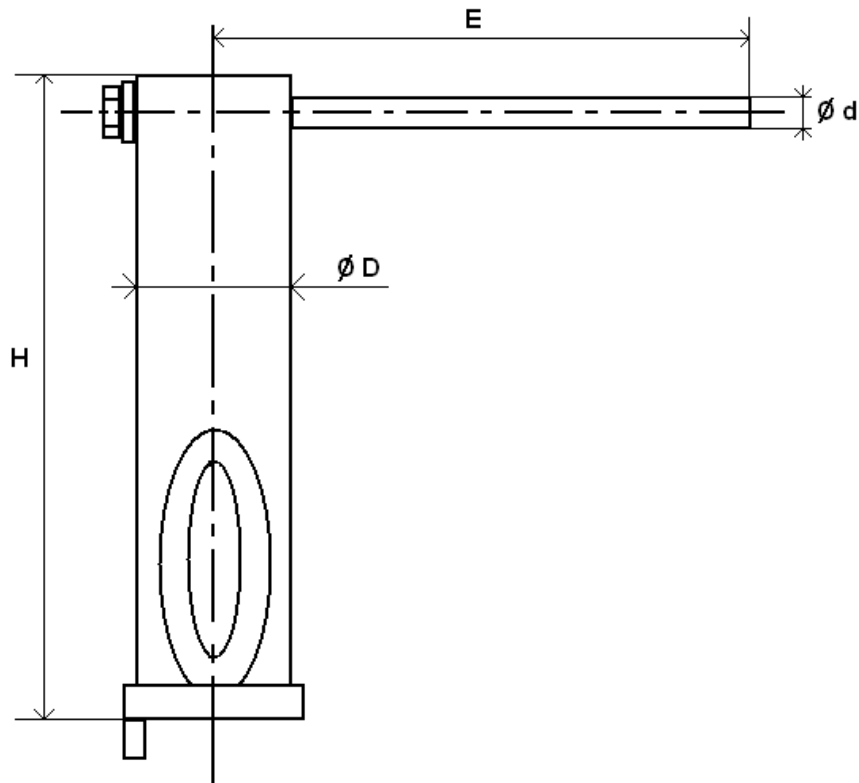

| Ref. | DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" |
|--------|---------------|-------|-------|-------|-------|-------|--------|--------|-------|
| 981060 | H | 125.5 | 125.5 | 125.5 | 125.5 | 125.5 | 125.5 | 127.5 | 127.5 |
| | E | 125 | 125 | 125 | 125 | 158 | 158 | 190 | 190 |
| | Ø D | 28 | 28 | 28 | 28 | 32 | 32 | 36 | 36 |
| | Ø d | 12 | 12 | 12 | 12 | 14 | 14 | 14 | 14 |
| | Weight (Kg) | 0.3 | 0.3 | 0.3 | 0.3 | 0.4 | 0.4 | 0.6 | 0.6 |

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE
TORQUE VALUES (In Nm without safety coefficient) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" | 2"1/2" | 3" | 4" |
|-------------|------|------|------|------|------|--------|--------|----|--------|----|-----|
| Torque (Nm) | 5 | 5 | 5 | 8 | 12.5 | 17 | 21 | 30 | 45 | 70 | 100 |

BOLT TIGHTENING TABLE (in Nm) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" | 2"1/2" | 3" | 4" |
|-------------|------|------|------|------|----|--------|--------|----|--------|----|----|
| Couple (Nm) | 4 | 4 | 8 | 8 | 10 | 13 | 20 | 20 | 35 | 45 | 65 |

FLOW COEFFICIENT Kvs (M3 / h) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" | 2"1/2" | 3" | 4" |
|--------------|------|-------|------|------|------|--------|--------|-------|--------|-----|--------|
| Kvs (m3/h) | 12.4 | 24.01 | 33 | 58.6 | 91.6 | 148.2 | 211.6 | 366.4 | 619.2 | 938 | 1465.6 |

STANDARDS :

- Fabrication according to ISO 9001 : 2008
- DIRECTIVE 97/23/CE : CE N° 0035
Risk Category III Module H
- Pressure tests according to EN 12266-1, rate A
- Threaded BSP cylindrical ends according to ISO 228-1
- Threaded NPT ends according to ANSI B1.20.1

ADVICE : Our opinion and our advice are not guaranteed and SFERACO shall not be liable for the consequences of damages.
The customer must check the right choice of the products with the real service conditions.

3 PIECES STAINLESS STEEL BALL VALVE PN63 INITIAL RANGE

INSTALLATION AND MAINTENANCE

BEFORE INSTALLATION :

Pipe-line must be cleaned and free from residual of weldings, rubbish, shaving and every kind of extraneous materials.
 Pipe-line must be perfectly aligned and their support properly dimensioned so that there's no external constraint.

Check to use a produce compatible to the services conditions for the sealing of the threaded types.
 To tighten the ends, use the appropriate tool.
 Use the right bolt tightening so that the ends won't be damaged.

The welding of the ends for the SW and the BW types, must be done with the central part removed.
 A gauge can be used to have the good length and alignment between the ends.

INSTALLATION OF THE CENTRAL PART

During the installation of the central part, tighten bolts according to the table below. Tighten bolts in cross.

BOLT TIGHTENING TABLE (in Nm) :

| DN | 1/4" | 3/8" | 1/2" | 3/4" | 1" | 1"1/4" | 1"1/2" | 2" | 2"1/2" | 3" | 4" |
|-------------|------|------|------|------|----|--------|--------|----|--------|----|----|
| TORQUE (Nm) | 4 | 4 | 8 | 8 | 10 | 13 | 20 | 20 | 35 | 45 | 65 |

CLEANING AND TESTS

Keep closed the valves during the cleaning operation so that there's no impurities between the ball and the body.

Tests under pressure must be done with a cleaned pipe-line.

Open partially the valve for tests. Pressure test do not exceed the valve specifications according to EN 12266-1.

MAINTENANCE

It's recommended to operate the valve twice (open and close) 1 to 2 times per year.

When intervention on the valve, be sure there's no pressure in the pipe-line, there's no fluid in it, and that it is isolated.
 The temperature must be low enough to operate without risks.
 If there's a corrosive fluid, inert installation before intervention.

When the valve is under pressure :
 If there's a leakage between the body and the ends, tighten bolts according to the above table

If there's a leakage at the packing, tighten it slightly so that the leakage disappears.

MAINTENANCE OPERATION IN WORKSHOP

REPLACEMENT OF SEAT GASKETS AND PACKING.

The central part must be removed.

Turn the ball at 45° and removed the seat gaskets.

Operate the valve in closed position to removed the ball. Verify the surface of the ball has no impacts and no scores.

If there are important scores or impacts, replace the ball.

Clean inside the body valve and remove the impurities.

To replace the packing, remove the handle, unscrew the gland nut, extract the stem by the inside of the valve.

Clean the packing seat.

Reassemble thrust washer on stem, introduce stem by the inside of the valve, reassemble packing with packing nut, reassemble hand washer, hand nut and the handle.

Turn stem in closed position and insert the ball.

Then turn the ball in opened position and reassemble the seat.

Place the valve on the installation, tighten bolts according to the above table.

Then proceed to the tests in the same way that the first installation.